

# Product Data and Specifications

## Available for Built to Order and QS Series

SAM Fan Filter Units and Light Fixtures are equipped with power cords for plugging into receptacles mounted on a top cross rail.

Receptacle(s) are connected to flexible conduit which connects to a field connection junction box.



A qualified electrician can then connect the host building power to the QS Softwall Cleanroom.

A control box mounted on a leg is equipped with switches for the SAM Units and Light Fixtures. The number of switches will be appropriate or in direct proportion to the number of SAM units and light fixtures.

Connecting to the building power source and compliance with state, city, county or township codes is the responsibility of the buyer.

Flexible Solutions Softwall Cleanrooms are considered a piece of equipment and are in compliance with accepted national practices for wiring of equipment.

Lead time for the electrical option requires an additional 5 business days. Consult with the factory for more information.

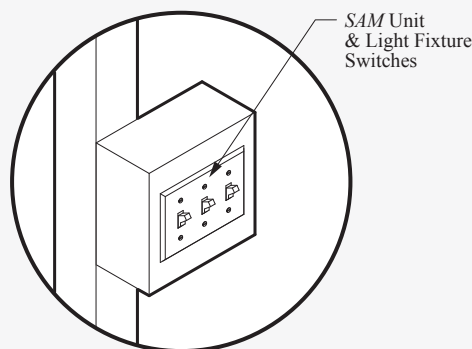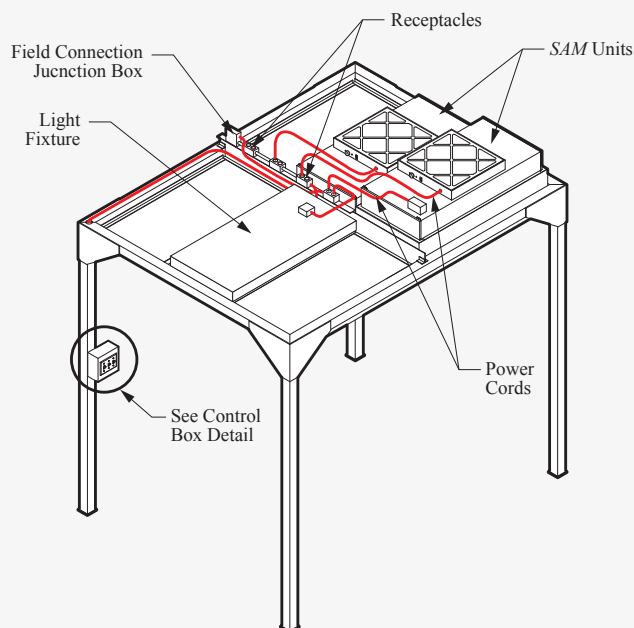

Control Box Detail

